



ALARMAGENT PUMP STATION REPORT

RTU NAME: DUPLEX PUMP STATION


Pump Runtime

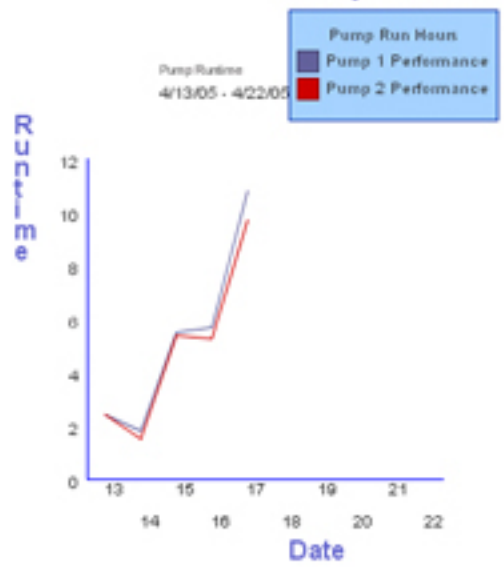

Pump GPM

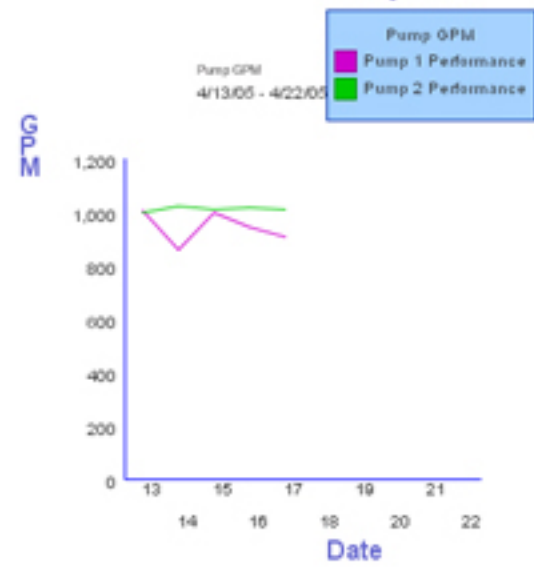

Starts Ratio

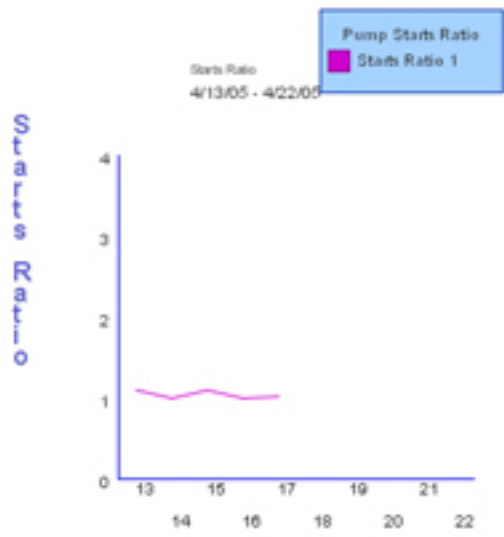

Station Flow

